



## TECHNICAL DATA

### STANDARD RESPONSE HIGH CHALLENGE® UPRIGHT SPRINKLER (CONTROL MODE SPECIFIC APPLICATION)

The Viking Corporation, 210 N Industrial Park Drive, Hastings MI 49058

Telephone: 269-945-9501 Technical Services: 877-384-5464 Fax: 269-818-1680 Email: techsvcs@vikingcorp.com

Visit the Viking website for the latest edition of this technical data page: [www.vikinggroupinc.com](http://www.vikinggroupinc.com)

### 1. DESCRIPTION

The Viking Standard Response High Challenge® Upright CMSA Sprinkler VK540 is a thermosensitive, glass-bulb sprinkler intended for use in protecting high piled storage occupancies in accordance with NFPA 13 rules for CMSA Sprinklers and FM Global criteria for non-storage and storage sprinklers.

The sprinkler produces large water droplets through the use of an extra-large orifice and a special double deflector. The large water droplets provide the required mass to penetrate the fire plume of severe fires. This characteristic permits direct wetting of the burning fuel while cooling the atmosphere and can eliminate the requirement for in-rack sprinklers in certain cases.

Viking VK540 Upright CMSA Sprinklers are primarily intended to protect the following types of storage, which tend to produce severe-challenge fires: palletized and solid pile storage and single, double, multiple row, and portable open rack storage (no open-top containers or solid shelves).

Viking High Challenge® Upright CMSA Sprinkler VK540 provides protection of most common storage materials, including:

- Class I, II, III, and IV commodities\*
- Cartoned or exposed unexpanded plastics\*
- Cartoned or exposed expanded plastics\*

\* Refer the Approval Charts and Design Criteria for cULus Listing and FM Approval requirements that must be followed.

In addition, some storage arrangements of idle wood pallets, rolled paper, aerosols, and rubber tires may be protected by Viking Upright CMSA Sprinkler VK540.

**NOTE:** Also known as the Large-Drop Sprinkler in the 2007 and prior editions of NFPA 13.

### 2. LISTINGS AND APPROVALS



cULus Listed: Category VNIV



FM Approved: Class 2007

NYC Approved: MEA 89-92-E, Volume 19

**NOTE:** Other International approval certificates are available upon request.

Refer to the Approval Charts and Design Criteria on this data page for Listing and Approval requirements that must be followed.

### 3. TECHNICAL DATA

#### Specifications:

Available since 1996.

Minimum Operating Pressure: Refer to NFPA 13 or FM Global loss prevention data sheets.

Rated to 175 psi (12 bar) water working pressure. Factory tested hydrostatically to 500 psi (34.5 bar).

Thread size: 1/2" (15 mm) NPT\*\*\* or 3/4" (20 mm) NPT

Nominal K-Factor: 11.2 U.S. (161.3 metric\*\*)

\*\* Metric K-factor measurement shown is when pressure is measured in Bar. When pressure is measured in kPa, divide the metric K-factor shown by 10.0.

\*\*\* For retrofit only.

Glass-bulb fluid temperature rated to -65 °F (-55 °C)

Overall Length: 3-5/16" (84 mm)

Deflector Diameter: 3-5/8" (92 mm)


Deflector: U.S.A. Patent No. 1,118,710

#### Material Standards:

Frame Casting: Brass UNS-C84400

Screw: Brass UNS-C36000

Pip Cap: Copper UNS-C11000 and UNS-S30400

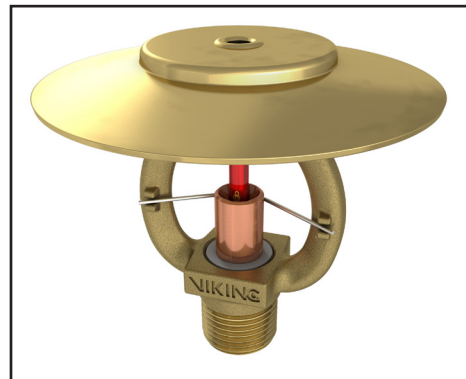

**WARNING:** Cancer and Reproductive Harm-  
[www.P65Warnings.ca.gov](http://www.P65Warnings.ca.gov)



## TECHNICAL DATA

### STANDARD RESPONSE HIGH CHALLENGE® UPRIGHT SPRINKLER (CONTROL MODE SPECIFIC APPLICATION)

The Viking Corporation, 210 N Industrial Park Drive, Hastings MI 49058

Telephone: 269-945-9501 Technical Services: 877-384-5464 Fax: 269-818-1680 Email: techsvcs@vikingcorp.com

Visit the Viking website for the latest edition of this technical data page: [www.vikinggroupinc.com](http://www.vikinggroupinc.com)

Belleville Spring Sealing Assembly: Nickel Alloy, coated on both sides with Teflon Tape

Deflector: Brass UNS-C26000

Bulb: Glass, nominal 5 mm diameter

**Ordering Information:** (Also refer to the current Viking price list.)

Order Standard Response High Challenge® Upright CMSA Sprinkler VK540 by first adding the appropriate suffix for the sprinkler finish and then the appropriate suffix for the temperature rating to the sprinkler base part number.

Finish Suffix: Brass = A

Temperature Suffix: 155 °F (68 °C) = B, 200 °F (93 °C) = E, and 286 °F (141 °C) = G

For example, sprinkler VK540 with a 3/4" thread, a Brass finish, and a 155 °F (68 °C) temperature rating = Part No. 13167AB.

**Available Finishes And Temperature Ratings: Refer to Table 1.**

**Accessories: (Also refer to the Viking website.)**

**Sprinkler Wrench:**

Part No. 05118CW/B, fits both 1/2" NPT and 3/4" NPT Sprinklers (available since 1981)

**Sprinkler Cabinet:**

Six-head capacity: Part No. 03985A (available since 1977)

#### 4. INSTALLATION

Refer to appropriate NFPA or FM Installation Standards.

#### 5. OPERATION

During fire conditions, the heat-sensitive liquid in the glass bulb expands, causing the glass to shatter, releasing the pip cap and sealing spring assembly. Water flowing through the sprinkler orifice strikes the sprinkler deflector, forming a uniform spray pattern to extinguish or control the fire.

#### 6. INSPECTIONS, TESTS AND MAINTENANCE

Refer to NFPA 25 for Inspection, Testing, and Maintenance requirements.

#### 7. AVAILABILITY

The Viking Model VK540 Sprinkler is available through a network of domestic and international distributors. See The Viking Corporation web site for the closest distributor or contact The Viking Corporation.

#### 8. GUARANTEE

For details of warranty, refer to Viking's current list price schedule or contact Viking directly.

**TABLE 1: AVAILABLE SPRINKLER TEMPERATURE RATINGS AND FINISHES**

Sprinkler Temperature Classification	Sprinkler Nominal Temperature Rating <sup>1</sup>	Maximum Ambient Ceiling Temperature <sup>2</sup>	Bulb Color
Ordinary	155 °F (68 °C)	100 °F (38 °C)	Red
Intermediate	200 °F (93 °C)	150 °F (65 °C)	Green
High	286 °F (141 °C)	225 °F (107 °C)	Blue

**Sprinkler Finish:** Brass

#### Footnotes

<sup>1</sup> The sprinkler temperature rating is stamped on the deflector.


<sup>2</sup> Based on NFPA-13. Other limits may apply, depending on fire loading, sprinkler location, and other requirements of the Authority Having Jurisdiction. Refer to specific installation standards.




**TECHNICAL DATA**

**STANDARD RESPONSE HIGH CHALLENGE® UPRIGHT SPRINKLER (CONTROL MODE SPECIFIC APPLICATION)**

The Viking Corporation, 210 N Industrial Park Drive, Hastings MI 49058  
 Telephone: 269-945-9501 Technical Services: 877-384-5464 Fax: 269-818-1680 Email: techsvcs@vikingcorp.com  
 Visit the Viking website for the latest edition of this technical data page: www.vikinggroupinc.com

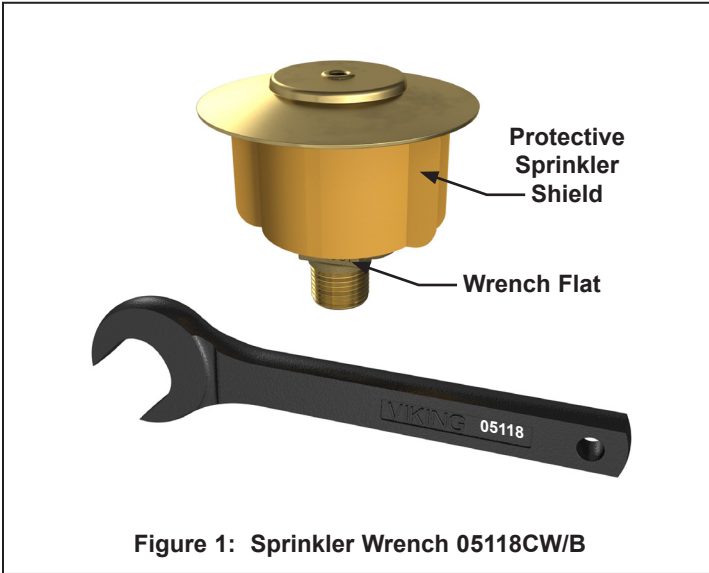

**Figure 1: Sprinkler Wrench 05118CW/B**

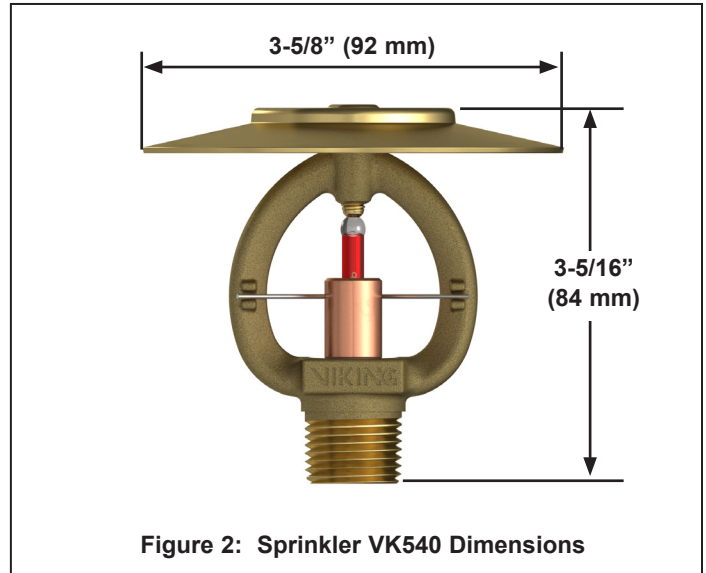

**Figure 2: Sprinkler VK540 Dimensions**

Approval Chart 1 (UL)													
Standard Response High Challenge® Upright CMSA Sprinklers, Maximum 175 PSI (12 bar) WWP													
Base Part Number <sup>1</sup>	SIN	NPT Thread Size		Nominal K-Factor		Overall Length		Listings and Approvals <sup>3</sup> (Refer also to Design Criteria on page 113d.)					
		Inches	mm	U.S.	metric <sup>2</sup>	Inches	mm	cULus <sup>4</sup>	NYC <sup>5</sup>	VdS	LPCB		
13166	VK540	1/2"	15 mm	11.2	161.3	3-5/16	84	A1 <sup>6</sup>	A1 <sup>6</sup>	--	--	--	--
13167	VK540	3/4"	20 mm	11.2	161.3	3-5/16	84	A1	A1	--	--	--	--
<b>Approved Temperature Ratings</b> A - 155 °F (68 °C), 200 °F (93 °C) and 286 °F (141 °C)							<b>Approved Finish</b> 1 - Brass						
<b>Footnotes</b>													
<sup>1</sup> Base part number shown. For complete part number, refer to the price list.													
<sup>2</sup> Metric K-factor shown is for use when pressure is measured in bar. When pressure is measured in kPa, divide the metric K-factor shown by 10.0.													
<sup>3</sup> This chart shows listings and approvals available at the time of printing. Other approvals may be in process.													
<sup>4</sup> Listed by Underwriters Laboratories Inc. for use in the U.S. and Canada.													
<sup>5</sup> Accepted for use, City of New York Department of Buildings, MEA 89-92-E, Vol. 19.													
<sup>6</sup> The 1/2" NPT Extra-Large Orifice Sprinkler is Listed and Approved for retrofit use only.													



## TECHNICAL DATA

### STANDARD RESPONSE HIGH CHALLENGE® UPRIGHT SPRINKLER (CONTROL MODE SPECIFIC APPLICATION)

The Viking Corporation, 210 N Industrial Park Drive, Hastings MI 49058

Telephone: 269-945-9501 Technical Services: 877-384-5464 Fax: 269-818-1680 Email: techsvcs@vikingcorp.com

Visit the Viking website for the latest edition of this technical data page: www.vikinggroupinc.com

### DESIGN CRITERIA - UL

(Also refer to Approval Chart 1.)

#### General Guidelines:

**Maximum Roof or Ceiling Slope:** 2 in 12 (167 mm/m or 9.5 degrees).

**Sprinkler Position:** Approved for use only in the upright position. Align the deflector parallel with the ceiling or roof.

**NOTE:** The use of internally galvanized steel pipe or copper pipe for dry systems and preaction systems using CMSA Sprinklers is required by some Installation Standards.

**Deflector Distance from Walls:** At least 4" (102 mm) from walls, and no more than one-half the allowable distance permitted between sprinklers.

**Clearance from Deflector to Top of Storage:** At least 36" (914 mm).

**Minimum Area of Coverage Allowed per Sprinkler:** 80 ft<sup>2</sup> (7.4 m<sup>2</sup>).

**Minimum Distance Between Sprinklers:** 8 ft. (2.4 m).

**Hydraulic Calculation Note:** To determine the number of sprinklers to calculate per branch line:

- Determine sprinkler spacing. (Refer to the appropriate Installation Standard and the Authority Having Jurisdiction.)
- Determine size of the remote area by multiplying the area of coverage per sprinkler by the number of sprinklers to be calculated (refer to the appropriate Installation Standard and the Authority Having Jurisdiction).
- Multiply the square root of the remote area determined in the step above by at least 1.2 and divide the product by the distance between sprinklers on the branch lines. The quotient determines the number of sprinklers to calculate per branch line. Any fractional sprinkler shall be carried to the next higher whole sprinkler.

**NOTE:** If the ceiling is beam and girder or panel construction, locate sprinklers in the bays rather than under the beams.

#### cULus Listing Requirements:

Standard Response High Challenge® Upright CMSA Sprinkler VK540 is cULus Listed as indicated in Approval Chart 1 for installation in accordance with the latest appropriate NFPA standards (including NFPA 13) for CMSA Sprinklers.

**System Types:** Wet, Dry, or Pre-action Systems based on the appropriate table in the applicable standard for the hazard being protected.

#### Deflector Position:

- **Under Unobstructed Construction:** Position the deflector between 6" and 8" (152 mm to 203 mm) below the ceiling.
- **Under Obstructed Construction,** locate in accordance with one of the following:
  - 1) Position the deflectors between of 6" and 12" (152 mm to 305 mm) below the ceiling.
  - 2) Install with the deflectors within the horizontal planes 1" to 6" (25.4 mm to 152 mm) below wood joist or composite wood joist construction, to a maximum distance of 22" (559 mm) below the ceiling/roof or deck.
  - 3) Install with the deflectors of sprinklers under concrete tee construction with stems spaces less than 7-1/2 ft. (2.3 m) but more than 3 ft. (0.9 m) on centers, regardless of the depth of the tee, located at or above a horizontal plane 1" (25.4 mm) below the bottom of the stems of the tees and shall comply with the obstruction rules in NFPA 13 for avoiding obstructions to discharge (Table 8.11.5.1.2 in the 2010 edition of NFPA 13).

#### Maximum Distance Between Sprinklers:

- Under unobstructed and obstructed noncombustible construction and unobstructed combustible construction, the distance between sprinklers shall be limited to not more than 12 ft. (3.7 m) between sprinklers, with the area of coverage per sprinkler limited to 130 ft<sup>2</sup> (12.1 m<sup>2</sup>).
- Under obstructed combustible construction and in rack storage applications, the distance between sprinklers shall be limited to not more than 10 ft. (3.1 m) between sprinklers, with the area of coverage per sprinkler limited to 100 ft<sup>2</sup> (9.3 m<sup>2</sup>).

The sprinkler installation and obstruction rules contained in NFPA 13 for CMSA sprinklers must be followed.

**IMPORTANT:** Always refer to Bulletin Form No. F\_091699 - Care and Handling of Sprinklers. Viking High Challenge® Upright CMSA Sprinklers are to be installed in accordance with the latest edition of Viking technical data, the latest standards of NFPA, and any other Authorities Having Jurisdiction, and also with provisions of governmental codes, ordinances, and standards whenever applicable.



## TECHNICAL DATA

### STANDARD RESPONSE HIGH CHALLENGE® UPRIGHT SPRINKLER (CONTROL MODE SPECIFIC APPLICATION)


The Viking Corporation, 210 N Industrial Park Drive, Hastings MI 49058

Telephone: 269-945-9501 Technical Services: 877-384-5464 Fax: 269-818-1680 Email: techsvcs@vikingcorp.com

Visit the Viking website for the latest edition of this technical data page: www.vikinggroupinc.com

### Approval Chart 2 (FM)

Standard Response Upright Sprinkler VK540  
Maximum 175 PSI (12 bar) WWP



Base Part Number <sup>1</sup>	SIN	NPT Thread Size		Nominal K-Factor		Overall Length		FM Approvals <sup>3,4</sup> (Refer also to Design Criteria below.)
		Inches	mm	U.S.	metric <sup>2</sup>	Inches	mm	
13166	VK540	1/2"	15 mm	11.2	161.3	3-5/16	84	A1 <sup>5</sup>
13167	VK540	3/4"	20 mm	11.2	161.3	3-5/16	84	A1
<b>Approved Temperature Ratings</b> A - 155 °F (68 °C), 200 °F (93 °C) and 286 °F (141 °C)							<b>Approved Finish</b> 1 - Brass	

#### Footnotes

<sup>1</sup> Base part number shown. For complete part number, refer to the price list.

<sup>2</sup> Metric K-factor shown is for use when pressure is measured in bar. When pressure is measured in kPa, divide the metric K-factor shown by 10.0.

<sup>3</sup> This chart shows the FM Approvals available at the time of printing. Other approvals may be in process.

<sup>4</sup> FM Approved as a standard response upright **Non-Storage** sprinkler and also FM Approved as a standard response upright **Storage** sprinkler. Refer to Design Criteria below.

<sup>5</sup> The 1/2" NPT Extra-Large Orifice Sprinkler is FM Approved for retrofit use only.

### DESIGN CRITERIA - FM

(Also refer to Approval Chart 2 above.)

#### FM Approval Requirements:

- Sprinkler VK540 is FM Approved as a standard response upright **Storage** sprinkler as indicated in the FM Approval Guide.
  - For specific application and installation requirements, reference the latest applicable FM Loss Prevention Data Sheets (including Data Sheets 2-0 and 8-9).
- Sprinkler VK540 is also FM Approved as a standard response upright **Non-Storage** sprinkler as indicated in the FM Approval Guide.
  - For specific application and installation requirements, reference the latest applicable FM Loss Prevention Data Sheets (including Data Sheet 2-0).

FM Global Loss Prevention Data Sheets contain guidelines relating to, but not limited to: minimum water supply requirements, hydraulic design, ceiling slope and obstructions, minimum and maximum allowable spacing, and deflector distance below the ceiling.

**NOTE: The FM installation guidelines may differ from cULus and/or NFPA criteria.**

**IMPORTANT: Always refer to Bulletin Form No. F\_091699 - Care and Handling of Sprinklers. Viking sprinklers are to be installed in accordance with the latest edition of Viking technical data, the appropriate standards of NFPA, FM Global, and any other Authorities Having Jurisdiction, and also with provisions of governmental codes, ordinances, and standards whenever applicable.**